

Figure 7.--Estimated volume of the better quality ground water (6,000 mg/l or less dissolved solids) in central St. Croix, V.I.

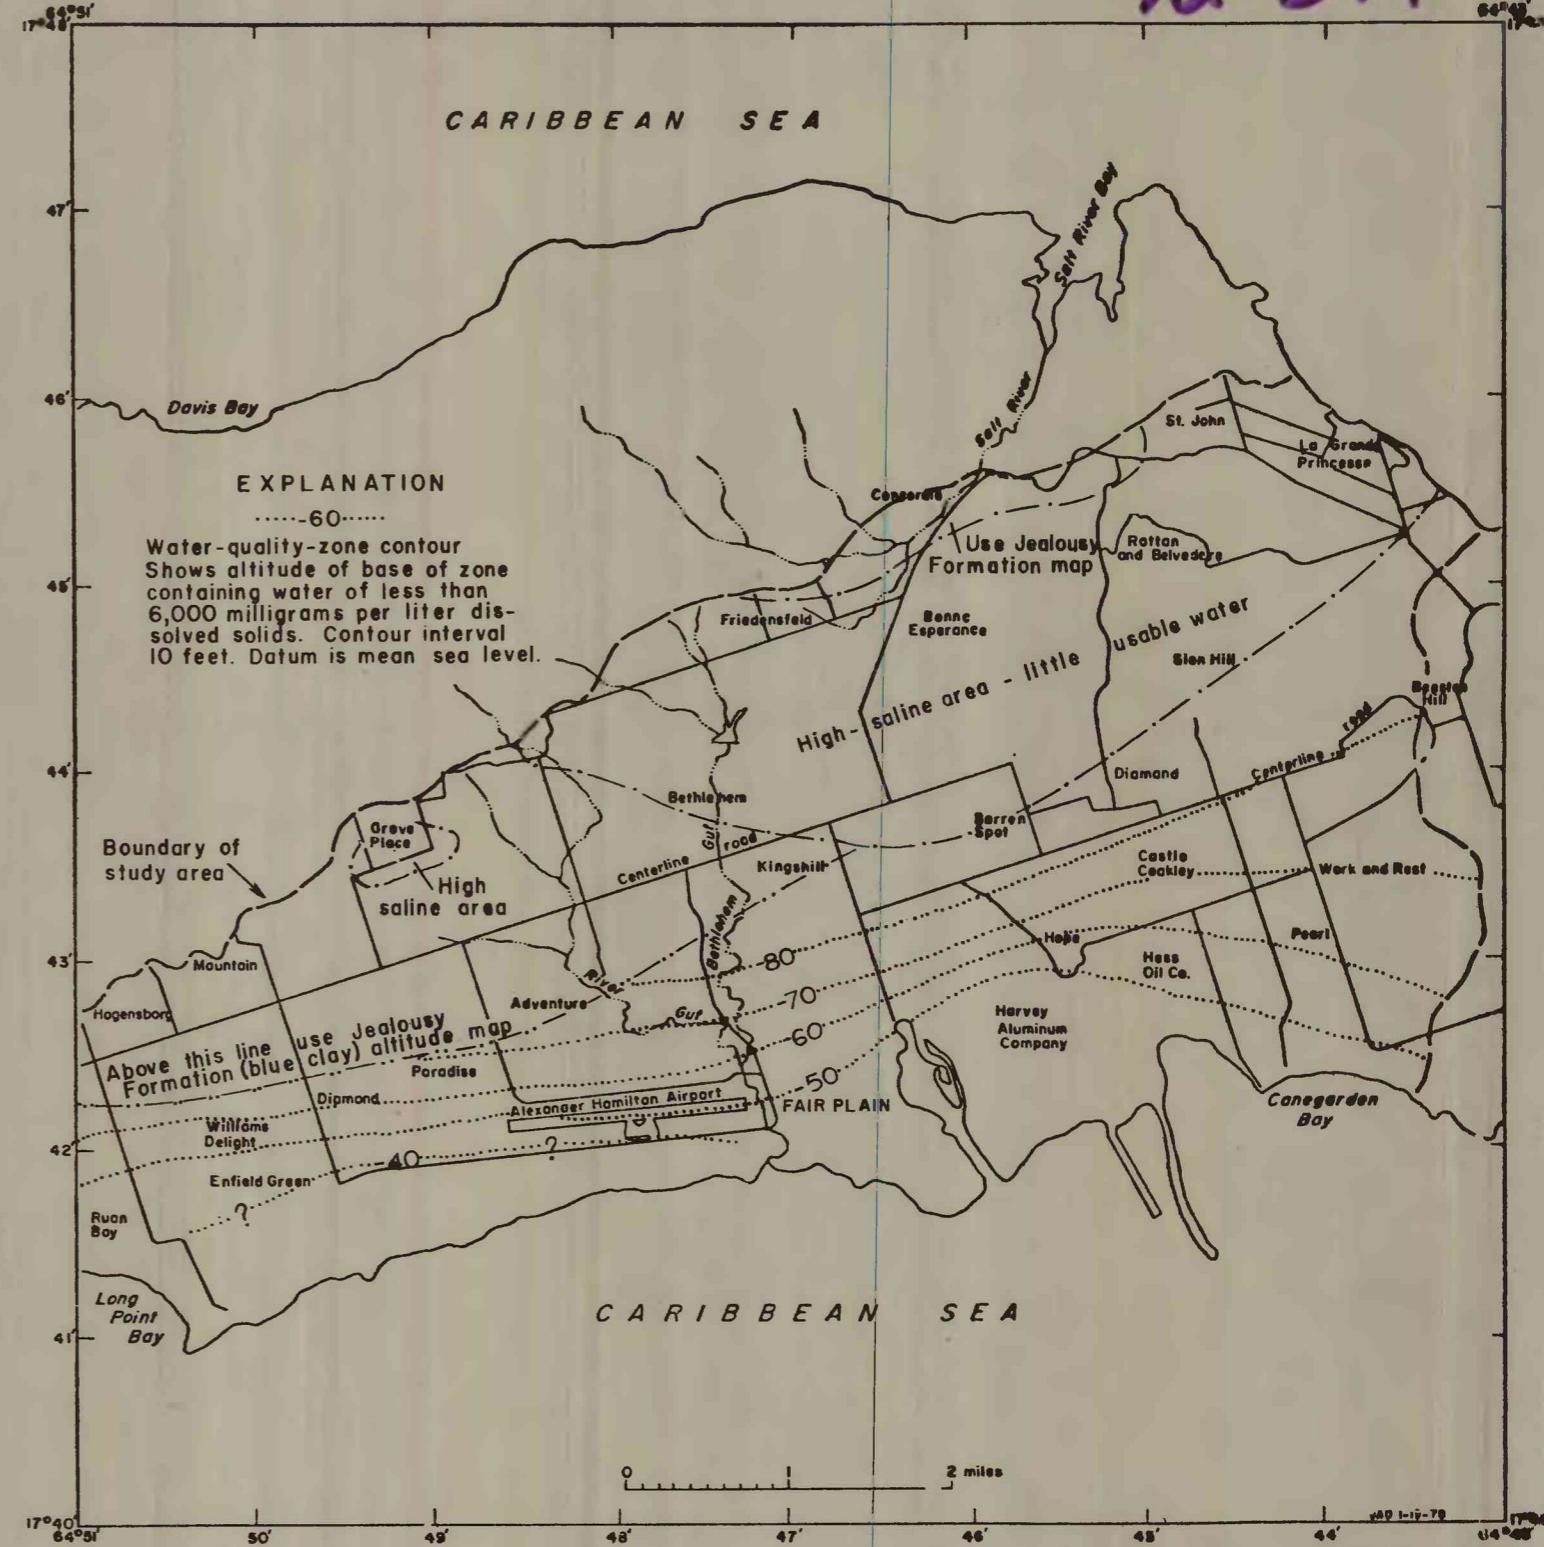


Figure 14.--Estimated altitude of the bottom of the better quality ground-water zone in central St. Croix, V.I. Inadequate data south of 50-foot contour.



Figure 13.--Estimated average dissolved-solids content of the better quality water (6,000 mg/l or less dissolved solids) in central St. Croix, V.I.

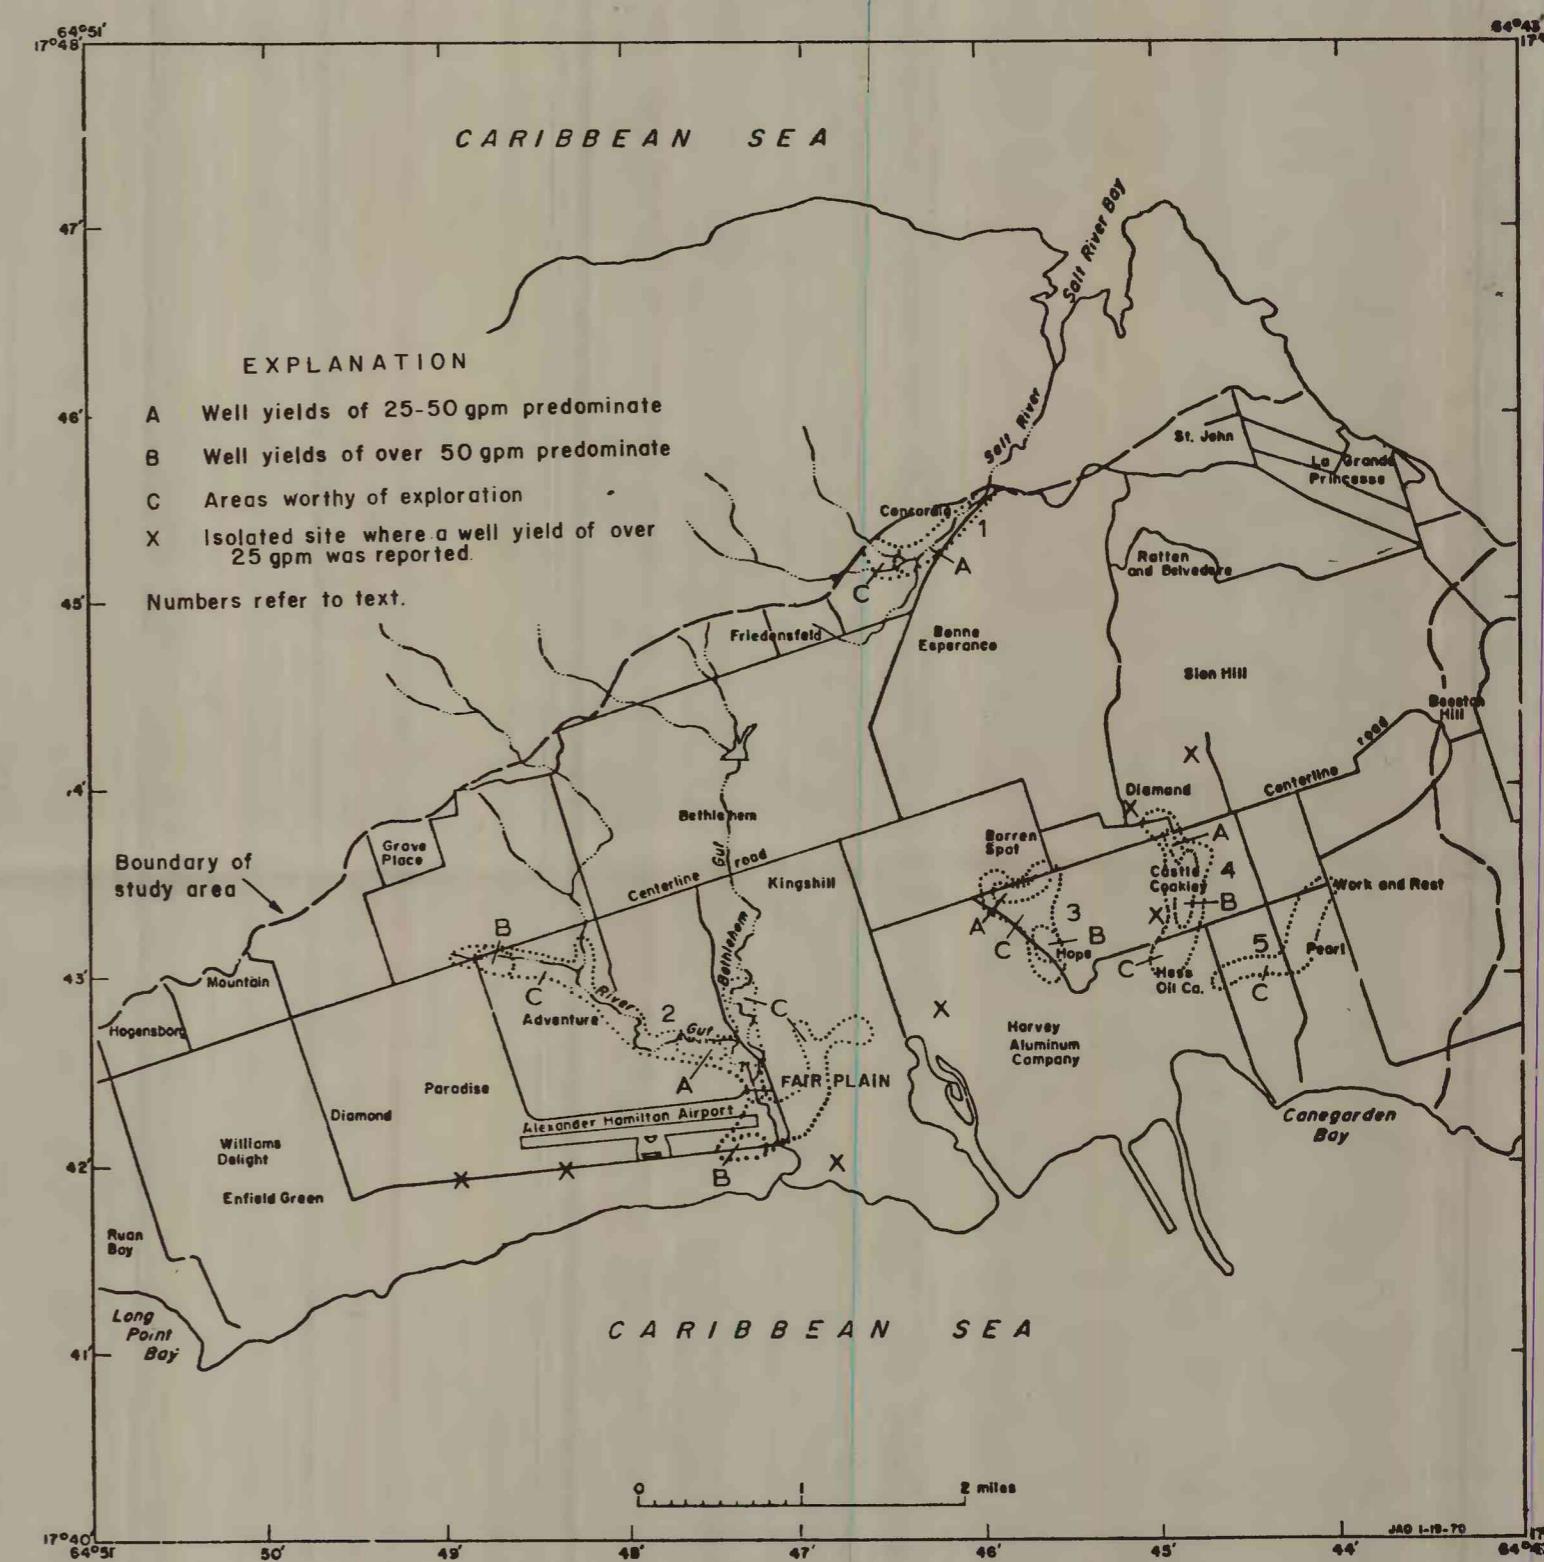


Figure 16.--Ground-water sites in central St. Croix, V.I. Numbered sites are discussed in the text.